

ESECUZIONE: EEx-d IIC II2G
CERTIFICATO: KEMA 01ATEX037
ZONA: zona 1 - zona 2 - zona 21 - zona 22


MATERIALE: Lega leggera
Classe T: T5 (EN 50014)
A richiesta: Guarnizione IP65

EXECUTION: EEx d IIC Group II2G
CERTIFICATE: KEMA 01ATEX037
ZONE: zone 1 - zone 2 - zone 21 - zone 22

MATERIAL: Light alloy (aluminium)
T Class: T5 (EN 50014)
Optional: Gaskets IP65




FSQ 215 - 325 - 425

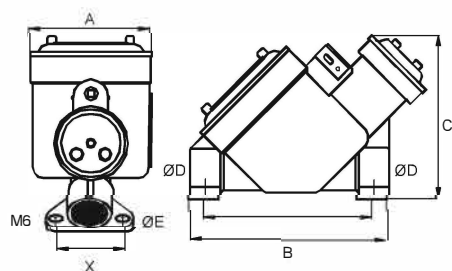DENOM.
DESIG.PRESE CON INTERRUTTORE SEMIROTATIVO A CAMMES
RECEPTACLES WITH INTERLOCKED CAM ROTARY SWITCH

sigla item	N° Poli Poles N°	Corrente Current	V max Voltage	A	B	C	ØD	ØE	X	Y	
FSQ 215	2P+T	25A	500	110	180	145	1"	7	60	160	
FSQ 325	3P+T	32A	500	110	180	145	1"	7	60	160	
FSQ 425	3P+N+T	32A	500	110	180	145	1"	7	60	160	
FSQ 360	3P+T	63A	500	155	246	190	1 1/2"	11	160	222	
FSQ 460	3P+N+T	63A	500	155	246	190	1 1/2"	11	160	222	

FSQ 360 - FSQA ..

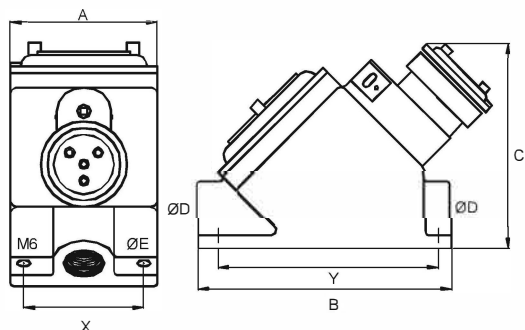DENOM.
DESIG.PRESE CON INTERRUTTORE MAGNETOTERMICO
RECEPTACLES WITH CIRCUIT BREAKER


FSQA 215	2P+T	25A	500	155	246	190	1"	11	160	222	
FSQA 325	3P+T	32A	500	155	246	190	1"	11	160	222	
FSQA 425	3P+N+T	32A	500	155	246	190	1"	11	160	222	(*)
FSQA 360	3P+T	63A	500	155	246	190	1 1/2"	11	160	222	
FSQA 460	3P+N+T	63A	500	155	246	190	1 1/2"	11	160	222	(*)

(*) magnetotermico in custodia separata - (*) circuit breaker into external enclosure

SCHEMI INSERIZIONE
PLUG SCHEMEN° Poli - Tensione
Poles N° - VoltageCorrente
CurrentSchema
Scheme

○ Alveolo (femmina)
Socket contact (female)

◐ Spinotto (maschio)
Plug contact (male)



2A	2B	3A	4A
2C	2D	3B	4B
3C	3F	3D	4D
4F	4E	4C	

2P - 24V	25A	2C
2P - 48V	25A	2D
2P - 110V	25A	2B
2P - 220V	25A	2A
3P - 380V	32A	3A
2P+1 - 24V	25A	3D (*)
3P - 380V	63A	3A
3P - 500V	32A	3B
4P - 380V	32A	4A
4P - 500V	32A	4B
4P - 500V	63A	4F
4P - 380V	63A	4C

(*) Apparecchi portatili


(*) Portable equipment

ESECUZIONE: EEx-d IIC II2G
CERTIFICATO: CESI 01ATEX037
ZONA: zona 1 - zona 2 - zona 21 - zona 22

MATERIALE: Lega leggera
Classe T: T5 (EN 50014)

EXECUTION: EEx d IIC Group II2G
CERTIFICATE: CESI 01ATEX037
ZONE: zone 1 - zone 2 - zone 21 - zone 22

MATERIAL: Light alloy (aluminium)
T Class: T5 (EN 50014)

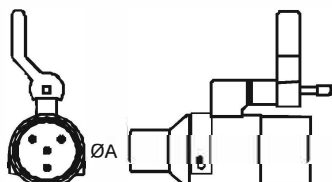

DENOM. DESIG.	SPINE PLUGS			
sigla item	N° Poli Poles N°	Corrente Current	V max Voltage	ØA
BP 215	2P+T	25A	500	3/4"
BP 325	3P+T	32A	500	3/4"
BP 425	3P+N+T	32A	500	3/4"
BP 360	3P+T	63A	500	1"
BP 460	3P+N+T	63A	500	1"

FSQV

PRESE DI CORRENTE CON INTERRUTTORE DI INTERBLOCCO E VALVOLE
RECEPTACLES WITH INTERLOCKED SWITCH AND FUSES

ESECUZIONE: EEx-d IIC II2G
CERTIFICATO: CESI 01ATEX037
KEMA 01ATEX2258
KEMA 01ATEX2257

ZONA: zona 1 - zona 2 - zona 21 - zona 22
MATERIALE: Lega leggera
Classe T: T5 (EN 50014)
A richiesta: Guarnizione IP65

EXECUTION: EEx d IIC Group II2G
CERTIFICATE: CESI 01ATEX037
KEMA 01ATEX2258
KEMA 01ATEX2257

ZONE: zone 1 - zone 2 - zone 21 - zone 22
MATERIAL: Light alloy (aluminium)
T Class: T5 (EN 50014)
Optional: Gaskets IP65



DENOM. DESIG.	N° Poli Poles N°	Alimentazione Feeding side	DENOM. DESIG.	N° Poli Poles N°	Alimentazione Feeding side	Corrente Current	Max Max					Custodia fusibili Fuses enclosure
sigla-item							V	A	B	C	ØD	
FSQV 215/B	2P+T	Dal basso/Down	FSQV 215/A	2P+T	Dall'Alto/Up	25A	500	155	180	410	1"	SC 29 (**)
FSQV 325/B	3P+T	Dal basso/Down	FSQV 325/A	3P+T	Dall'Alto/Up	32A	500	155	180	410	1"	SC 29 (**)
FSQV 425/B	3P+N+T	Dal basso/Down	FSQV 425/A	3P+N+T	Dall'Alto/Up	32A	500	155	180	410	1"	SC 29 (**)
FSQV 360/B	3P+T	Dal basso/Down	FSQV 360/A	3P+T	Dall'Alto/Up	63A	500	175	220	480	1 1/2"	EJB 755 (*)
FSQV 460/B	3P+N+T	Dal basso/Down	FSQV 460/A	3P+N+T	Dall'Alto/Up	63A	500	175	220	480	1 1/2"	EJB 755 (*)

KEMA 01ATEX2257 (*) - KEMA 01ATEX2258 (**)

